



Parts List					
ITEM	QTY	ID	OD	DESCRIPTION	PART NUMBER
1	1			IPPL2SAS200404	StartingAdapter4218
2	17	--	24 in	WALL GUIDE	IPPL2WG200404-04
3	1	--	24 in	GUY WIRE BAND	IPPL2GWB200404-04
4	1	--	24 in	HANGER BRACKET	IPPL2HB200404-STD
5	2	--	24 in	WALL FIRE STOP	IPPL2WFS200404-STD
6	6	--	24 in	WALL SUPPORT	IPPL2WS200404-04
7	1	20 in	24 in	36" LENGTH	IPPL236L200404
8	1	20 in	24 in	DRAIN TEE CAP	IPPL2DC200404
9	1	20 in	24 in	90° TEE	IPPL2T90200404
10	1	20 in	24 in	EXHAUST CONE	IPPL2EC200404
11	46	20 in	24 in	48" LENGTH	IPPL248L200404
12	1	20 in	24 in	ADJUSTABLE LENGTH	IPPL2AL200404
13	1	20 in	24 in	12" LENGTH	IPPL212L200404
14	6	20 in	24 in	24" LENGTH	IPPL224L200404
15	1	20 in	24 in	90° ELBOW	IPPL2E90200404

51 5TH Avenue, New York, NY

3	2013-08-02	FOR APPROVAL	MM
2	13-07-22	FOR APPROVAL	G.D.
No.	Date de rev.	Revision	Par

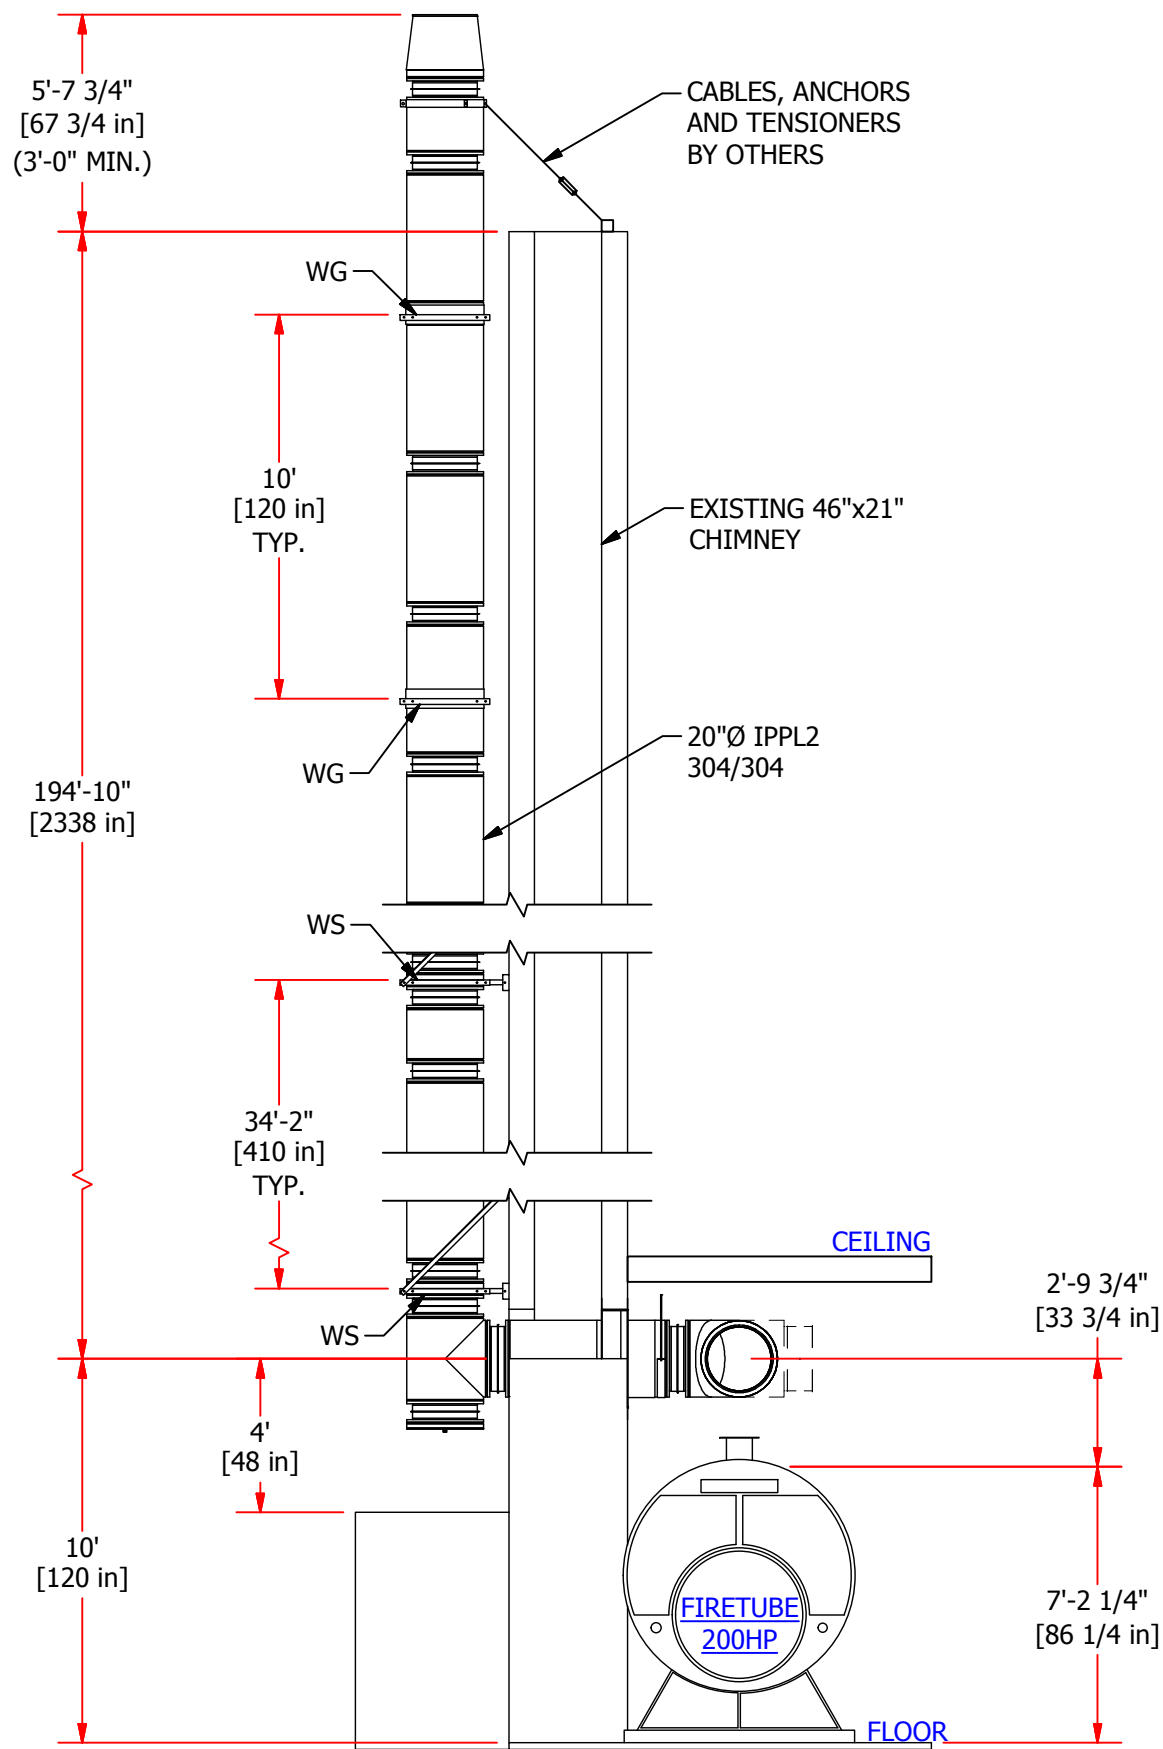

ELEVATION VIEW

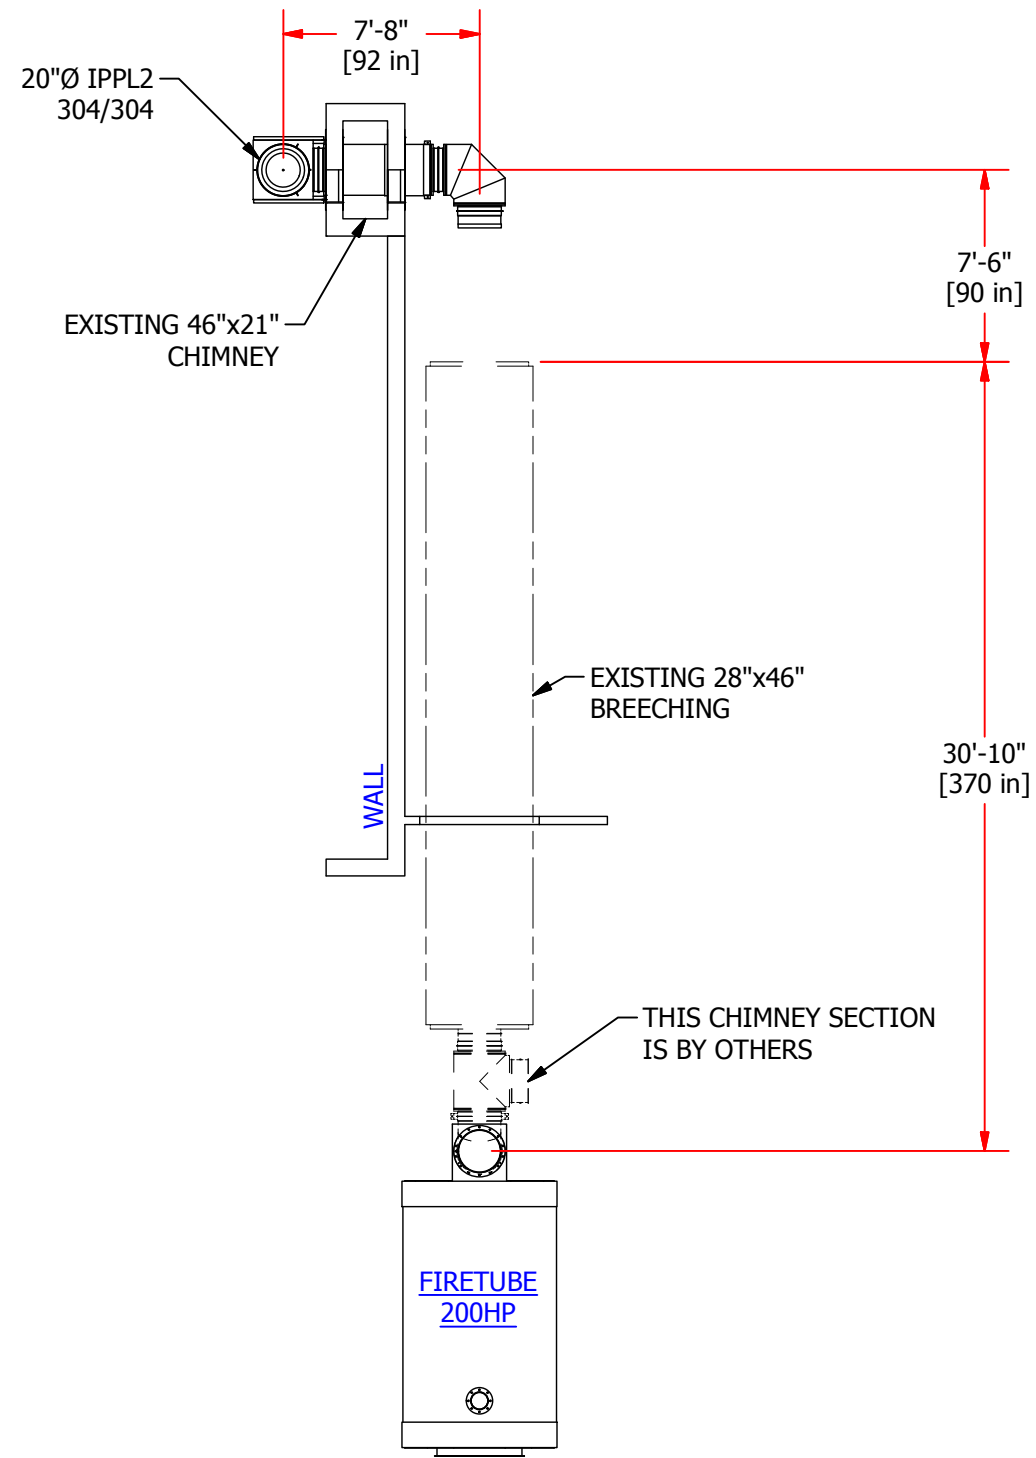

TOP VIEW

NOTE:
 The item(s) contained in this bill of material will be built solely for this job; your PO number: This document must be field verified and/or approved before the order will be entered for manufacturing. Any additional parts not shown on this document will need to be ordered with a different purchase order.

Approval signature: _____ Approval date: _____

3	2013-01-02	FOR APPROVAL	MM
2	13/07/22	FOR APPROVAL	G.D.
1	13/05/15	FOR REVISION	NL
No.	Date	Revision	By

IPPL2 CHIMNEY SYSTEM
 Is a prefabricated modular venting system, designed for both quick assembly and pressure tight capacity using a big and small end jointing.

This double-walled chimney system is tested in accordance with UL 103 (section 22A) and CAN/ULC-C959 standards and carry the appropriate ULC & UL/ULC label.

The maximum continuous operating temperature is 540°C (1000°F) suitable for all type of combustible. This system has been tested up to a 60" water column pressure.

Chimney:
 Inner wall: 20 gauge 304 2B stainless steel
 Insulation: 2" of mineral fiber insulation
 Outer wall: 24 gauge 304 2B stainless steel

Chimney	Minimum opening
20"Ø	36" x 36"

Project: 51 FIFTH AVENUE
 51 5TH AVE
 NEW YORK, NY, 10003-4320
 Tel.: (718)321-3621 Fax: (718)321-8391

Client: AMERICAN VENTILATION SERVICES
 26-16 123 RD STREET
 COLLEGE POINT, NY, 11354
 Tel.: (718)321-3621 Fax: (718)321-8391

Project manager: **Benoît Perron**

Draw. by:	Verif. by:	Appr. by:	Scale:	Date:
M.D.	B.P.	B.P.	NTS	2013-04-29
Title: 20"Ø IPPL2 304/304 FIRETUBE 200HP				
No. Project:	No. Drawing:	Sheet:	Rev.:	
30243	30243-A	2 / 3	3	